
26 november 2022 Bigshots Nieuwezijdsvoorburgwal 89

Device type	SVAN 971
Serial No.	84012
Pre Calibration type	By measurement
Pre Calibration date	26-11-2022
Pre Calibration time	23:02:56
Post Calibration type	By measurement
Post Calibration date	27-11-2022
Post Calibration time	02:46:26
Pre Calibration factor	1.6 dB
Pre Calibration level	94.0 dB
Post Calibration factor	1.7 dB
Post Calibration level	94.0 dB
Calibration drift	-0.0 dB

1S478.SVL : Logger results

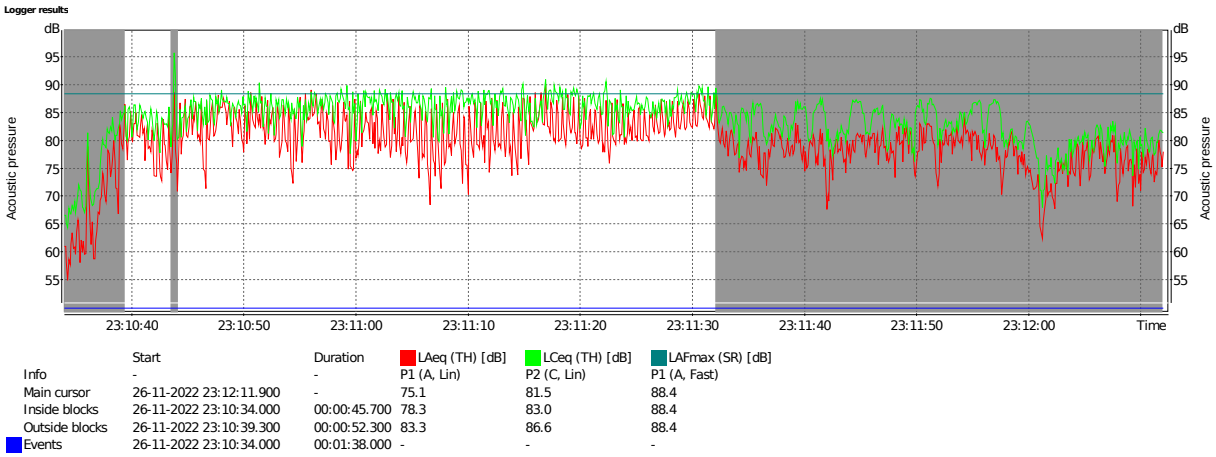

	Start	Duration	LAeq (TH) [dB]	LCeq (TH) [dB]	LAFmax (SR) [dB]
Info	-	-	P1 (A, Lin)	P2 (C, Lin)	P1 (A, Fast)
Main cursor	26-11-2022 23:12:11.900	-	75.1	81.5	88.4
Inside blocks	26-11-2022 23:10:34.000	00:00:45.700	78.3	83.0	88.4
Outside blocks	26-11-2022 23:10:39.300	00:00:52.300	83.3	86.6	88.4
Events	26-11-2022 23:10:34.000	00:01:38.000	-	-	-

83,3 dB(A) en 86,6 dB(C)