Bigshots,Warmoesstraat 94 29juli 2023 00:21uur

Device type	SVAN 971	
Serial No.	84015	
Pre Calibration type	By measurement	
Pre Calibration date	28-7-2023	
Pre Calibration time	18:44:34	
Post Calibration type	By measurement	
Post Calibration date	29-7-2023	
Post Calibration time	03:25:32	
Pre Calibration factor	1.1 dB	
Pre Calibration level	94.1 dB	
Post Calibration factor	0.9 dB	
Post Calibration level	94.1 dB	
Calibration drift	0.2 dB	

2S665.SVL : Logger results, zoom out = 6x (max envelope)

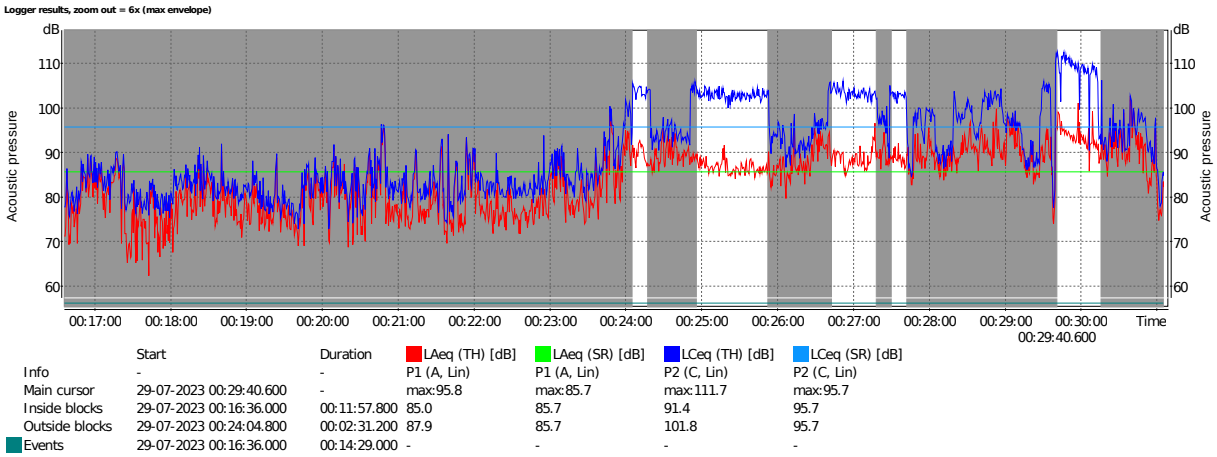

	Start	Duration	LAeq (TH) [dB]	LAeq (SR) [dB]	LCeq (TH) [dB]	LCeq (SR) [dB]
Info	-	-	P1 (A, Lin)	P1 (A, Lin)	P2 (C, Lin)	P2 (C, Lin)
Main cursor	29-07-2023 00:29:40.600	-	max:95.8	max:85.7	max:111.7	max:95.7
Inside blocks	29-07-2023 00:16:36.000	00:11:57.800	85.0	85.7	91.4	95.7
Outside blocks	29-07-2023 00:24:04.800	00:02:31.200	87.9	85.7	101.8	95.7
Events	29-07-2023 00:16:36.000	00:14:29.000	-	-	-	-